



**PLAN**

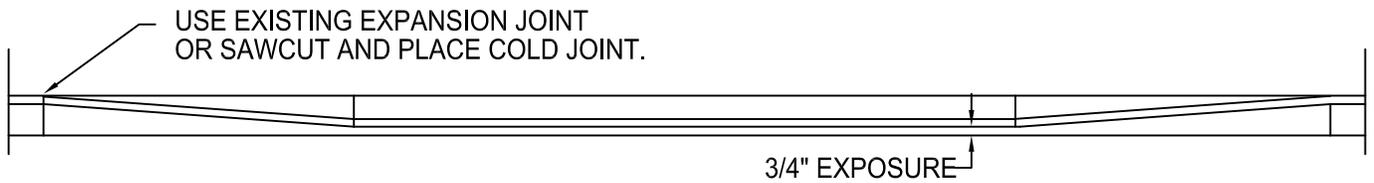

**ELEVATION**

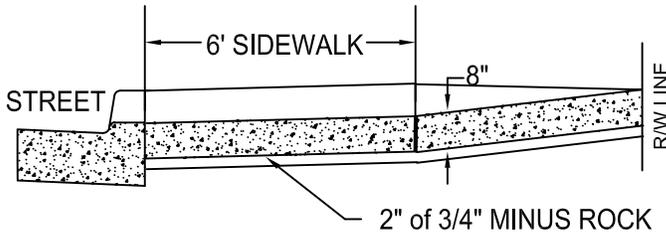

**SECTION A-A**

**NOTES:**

- 1. CONCRETE TO HAVE STRENGTH OF 3000 P.S.I. IN 28 DAYS.
- 2. CURB JOINT SHALL BE A TROWELED JOINT WITH A MINIMUM 1/2" RADIUS ALONG BACK OF CURB.
- 3. ISOLATION JOINTS SHALL BE 1/2" PREMOLDED ASPHALT IMPREGNATED MATERIAL OR EQUAL EXTENDING FROM SUBGRADE TO FINISHED GRADE.
- 4. EXPANSION JOINT SPACING SHALL BE A MAXIMUM OF 12'.
- 5. SUB GRADE SHALL BE FIRM WITH NO SOFT SPOTS WITH A MINIMUM OF 2" OF 3/4-0" ROCK

**NON-RESIDENTIAL DRIVEWAY  
(CURBSIDE SIDEWALK)**

**ENGINEERING  
DEPARTMENT**  
1924 COUNCIL STREET  
P.O. BOX 326  
FOREST GROVE, OR 97116

