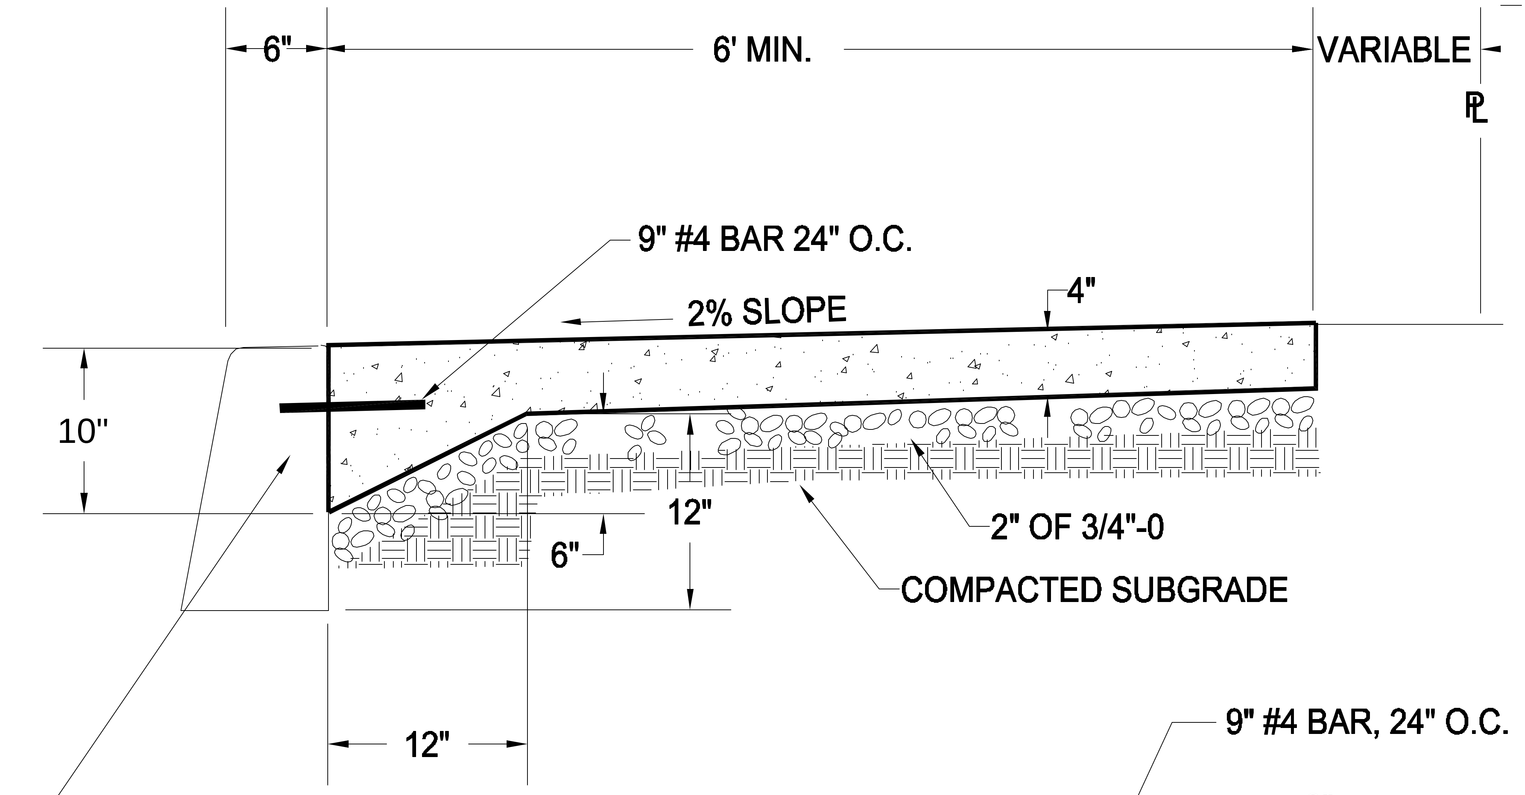

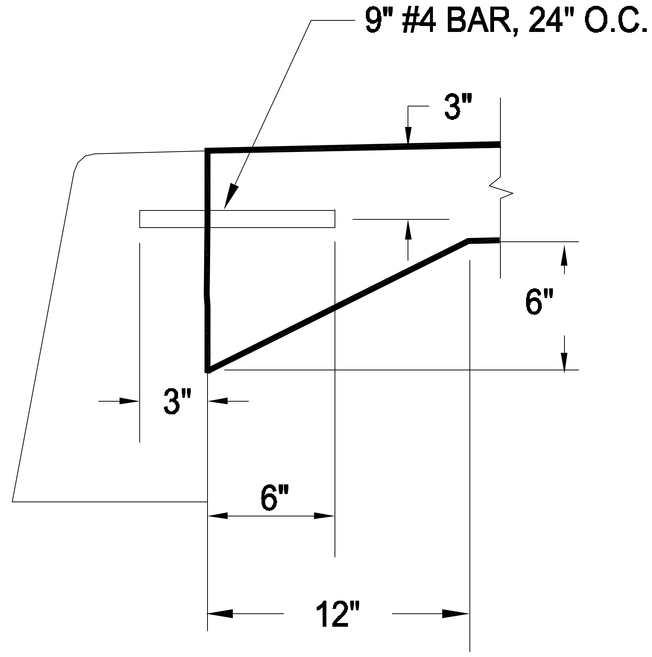

NOTES:

1. CONCRETE TO HAVE STRENGTH OF 3000 P.S.I. IN 28 DAYS 2" TO 4" SLUMP.
2. STEEL TIES-9" #4 BAR 24" O.C.
3. PANELS TO BE 5 FEET LONG
4. EXPANSION JOINTS TO BE PLACED AT SIDES OF DRIVEWAY APPROACHES, UTILITY VAULTS & AT SPACING NOT TO EXCEED 90' OR AS DIRECTED BY THE ENGINEER.
5. DRAIN BLOCKOUTS IN CURBS SHALL BE EXTENDED TO BACK OF SIDEWALK WITH 3" DIA. SCH. 40 ABS OR PVC PIPE AT 2% SLOPE, CONTRACTION JOINT TO BE PLACED OVER PIPE.
6. BROOM TRANSVERSE TO DIRECTION OF PEDESTRIAN TRAVEL (TYP.)

CURBLINE SIDEWALK 6' DOWELED INTO EXISTING CURB

ENGINEERING DEPARTMENT
1924 COUNCIL STREET
P.O. BOX 326
FOREST GROVE, OR 97116

city of forest grove