


NOTES:

1. CONCRETE TO HAVE STRENGTH OF 3000 P.S.I. IN 28 DAYS 2" TO 4" SLUMP.
2. KEYED COMBINATION CURB & SIDEWALK WILL ONLY BE PERMITTED TO BE USED WHEN THE ENGINEER DETERMINES THAT IT IS NOT FEASIBLE TO CONSTRUCT MONOLITHIC COMBINATION CURB & SIDEWALK.
3. PANELS TO BE 5' LONG.
4. EXPANSION JOINTS TO BE PLACED AT SIDES OF DRIVEWAY APPROACHES, UTILITY VAULTS & AT SPACING NOT TO EXCEED 90' OR AS DIRECTED BY THE ENGINEER.
5. FOR SIDEWALKS ADJACENT TO THE CURB & POURED AT THE SAME TIME AS THE CURB . THE JOINT BETWEEN THEM SHALL BE A TROWELED JOINT WITH A MIN. 1/2" RADIUS.
6. DRAIN BLOCKOUTS IN CURBS SHALL BE EXTENDED TO BACK OF SIDEWALK WITH 3" DIA. SCH. 40 ABS OR PVC PIPE AT 2% SLOPE, CONTRACTION JOINT TO BE PLACED OVER PIPE.
7. SIDEWALKS SHALL HAVE A MINIMUM THICKNESS OF 6" IF MOUNTABLE CURB IS USED OR, IF THE SIDEWALK IS INTENDED AS A PORTION OF A DRIVEWAY. OTHERWISE, SIDEWALKS SHALL HAVE A MINIMUM THICKNESS OF 4 ".
8. BROOM TRANSVERSE TO DIRECTION OF PEDESTRIAN TRAVEL (TYP.)
9. PLACING CONCRETE IN COLD WEATHER: DO NOT PLACE CONCRETE WHEN THE AMBIENT TEMPERATURE IS BELOW 40 DEGREES F. ANY CONCRETE DAMAGED BY FREEZING SHALL BE REMOVED AND REPLACED AT NO ADDITIONAL COST TO THE OWNER.

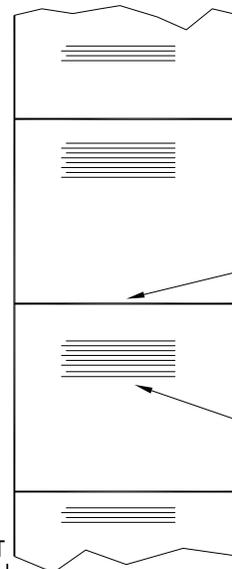

1 1/4" DEEP SCORE (TYP.)

TRANSVERSE LIGHT BROOM FINISH

CONCRETE SIDEWALK

ENGINEERING DEPARTMENT
 1924 COUNCIL STREET
 P.O. BOX 326
 FOREST GROVE, OR 97116

