


**NOTES:**

**① UNTREATED SUBGRADE**

THE CONTRACTOR SHALL EXCAVATE AND SHAPE SUBGRADE TO LINE, GRADE AND CROSS SECTION AND COMPACT TO NOT LESS THAN 95 PERCENT OF MAXIMUM DENSITY AS DETERMINED BY AASHTO T99. TESTING METHODS FOR DENSITY REQUIREMENTS SHALL BE DETERMINED BY AASHTO T191, T205, OR T238. THE CONTRACTOR SHALL COMPACT TO A LINE ONE FOOT BEYOND THE EDGE OF PAVING, CURB OR FORM.

SUBGRADE AREAS WHICH CANNOT BE COMPACTED TO SPECIFIED DENSITY, BUT IN THE JUDGEMENT OF THE ENGINEER OTHERWISE MEET THE REQUIREMENTS HEREIN, MAY BE REMOVED AND AERATED OR STABILIZED WITH AN APPROVED SOIL STABILIZING MATERIAL, ALL AT NO ADDITIONAL EXPENSE TO THE OWNER.

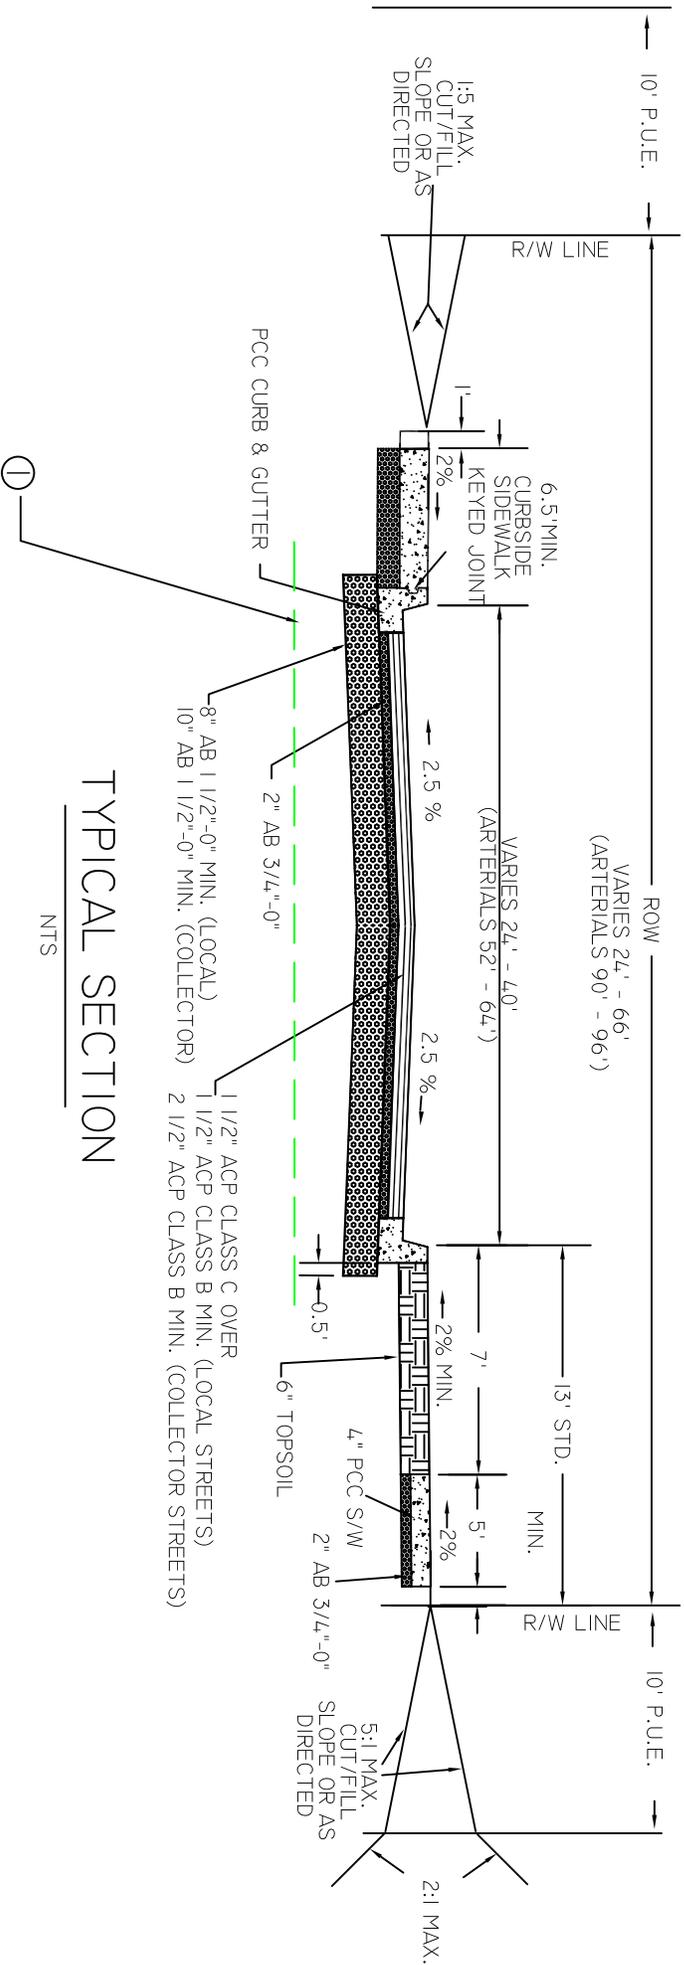

**TYPICAL SECTION**

NTS

**TYPICAL STREET SECTION**

**ENGINEERING  
DEPARTMENT**  
1924 COUNCIL STREET  
P.O. BOX 326  
FOREST GROVE, OR 97116

