



PLAN

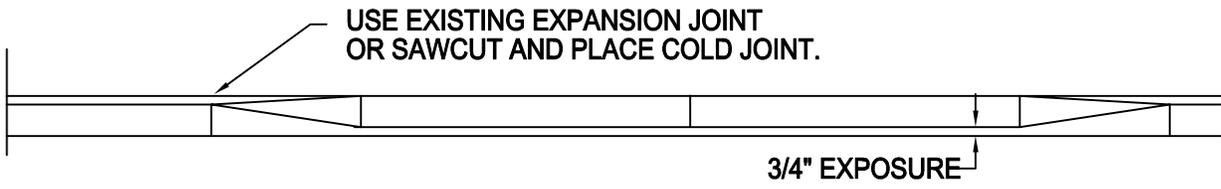

ELEVATION

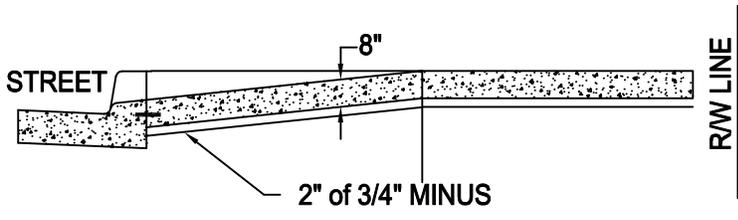

SECTION A-A

NOTES:

1. CONCRETE TO HAVE STRENGTH OF 3000 P.S.I. IN 28 DAYS.
2. CURB JOINT SHALL BE A TROWELED JOINT WITH A MINIMUM 1/2" RADIUS ALONG BACK OF CURB.
3. ISOLATION JOINTS SHALL BE 1/2" PREMOLDED ASPHALT IMPREGNATED MATERIAL OR EQUAL EXTENDING FROM SUBGRADE TO FINISHED GRADE.
4. EXPANSION JOINT SPACING SHALL BE A MAXIMUM OF 12'.
5. STEEL TIES 9" LONG, DRILL HOLES 3" INTO EXISTING CURB, INSTALL #4 REBAR 24" ON CENTER.

LEGEND:

↓ CROSS SLOPE 1.5% MAX (MAX 2.0 % FINISHED SURFACE SLOPE)



NON-RESIDENTIAL DRIVEWAY
(PROPERTY LINE SIDEWALK)

ENGINEERING
DEPARTMENT
1924 COUNCIL STREET
P.O. BOX 326
FOREST GROVE, OR 97116

DRAWING NO.
108

SCALE
NONE