



PLAN



ELEVATION

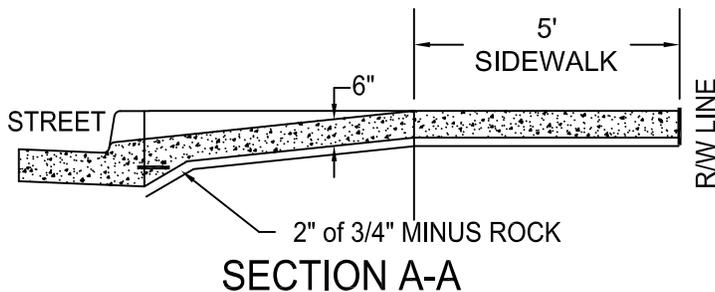

SECTION A-A

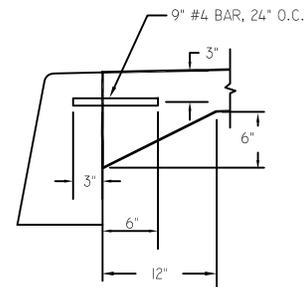

NOTES:

1. CONCRETE TO HAVE STRENGTH OF 3000 P.S.I. IN 28 DAYS.
2. CURB JOINT SHALL BE A TROWELED JOINT WITH A MINIMUM 1/2" RADIUS ALONG BACK OF CURB.
3. ISOLATION JOINTS SHALL BE 1/2" PREMOLDED ASPHALT IMPREGNATED MATERIAL EXTENDING FROM SUBGRADE TO FINISHED GRADE, NO WOOD PRODUCTS ALLOWED.
4. EXPANSION JOINT SPACING SHALL BE A MAXIMUM OF 12'.
5. SUB GRADE SHALL BE FIRM WITH NO SOFT SPOTS WITH A MINIMUM OF 2" OF 3/4-0" ROCK.
6. STEEL TIES 9" LONG DRILL HOLE 3" INTO EXISTING CURB 4# BAR 24" ON CENTER.

**RESIDENTIAL DRIVEWAY
SIDEWALK AWAY FROM CURB**

**ENGINEERING
DEPARTMENT**
1924 COUNCIL STREET
P.O. BOX 326
FOREST GROVE, OR 97116

