



PLAN VIEW

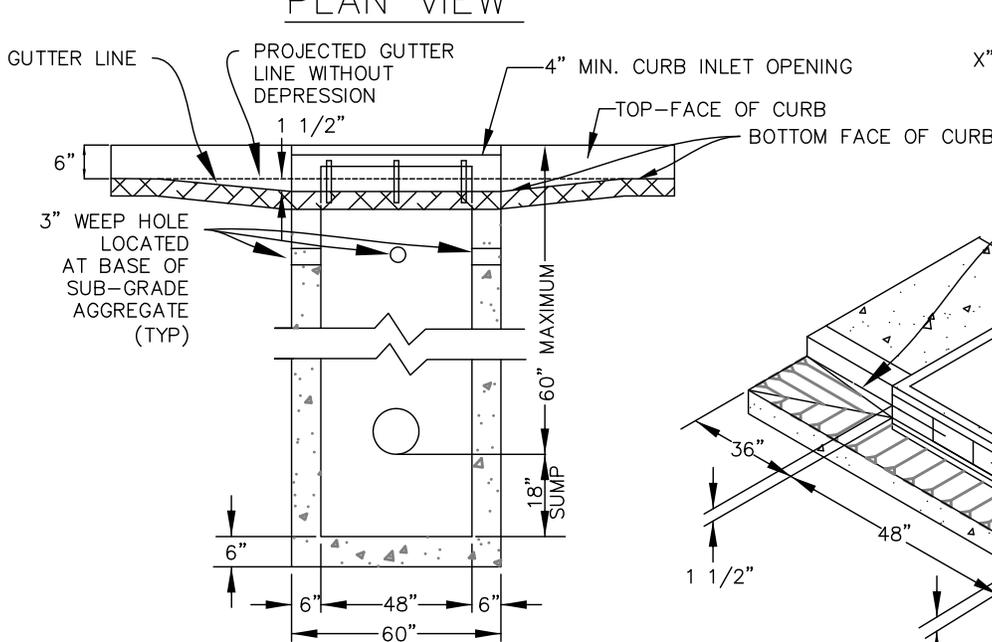

FRONT VIEW

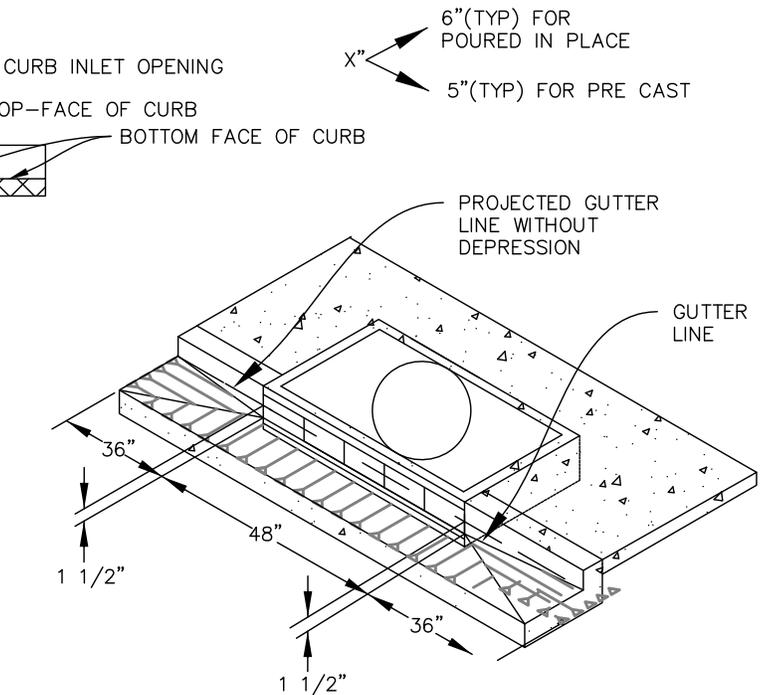

PERSPECTIVE VIEW SHOWING DEPRESSED GUTTER AT CURB INLET

NOTES:

1. ALL FABRICATED METAL PARTS SHALL BE NEW STRUCTURAL, ASTM A-36 STEEL, AND BE HOT-DIPPED GALVANIZED AFTER FABRICATION.
2. ALL POURED IN PLACE CONCRETE SHALL HAVE A 28 DAY STRENGTH OF 3000 P.S.I. AND A SLUMP OF 2" TO 4".
3. INSTALL STRUCTURE ON MINIMUM OF 8" OF 3/4" TO 0" COMPACTED BASE MATERIAL.
4. NON-SUMP INLET CATCH BASINS SHALL BE CHanneLED (E.G. FLOW THROUGH CBs).

INLET CATCH BASIN (CG-48)

DRAWING NO. 340

REVISED 12-16

